
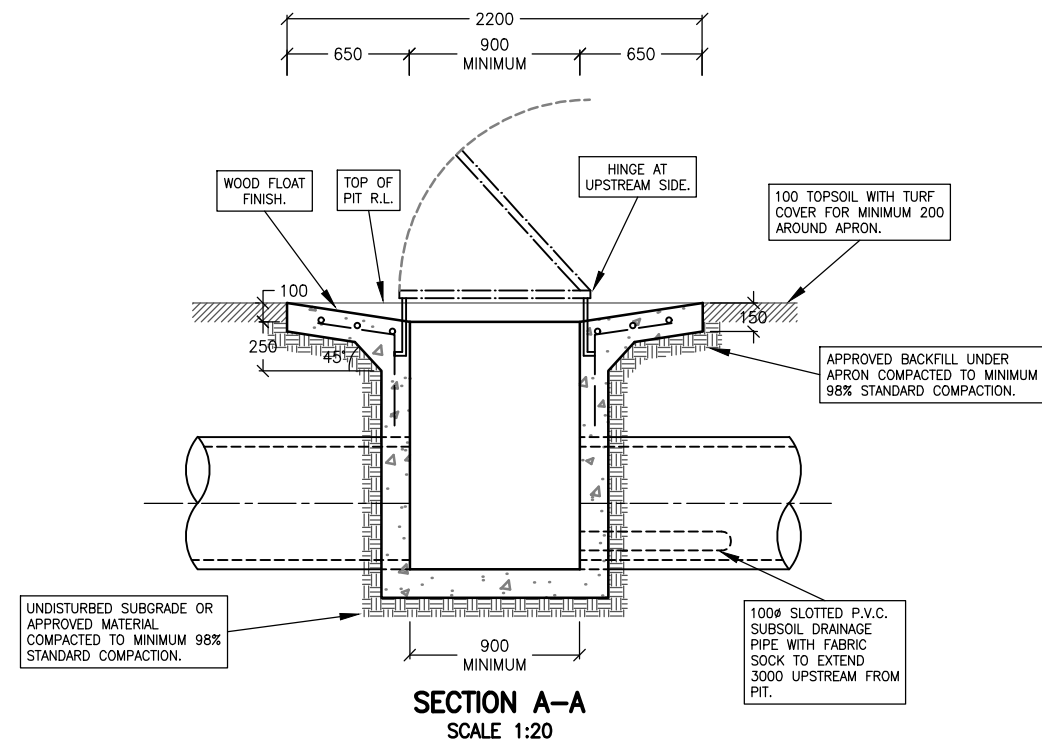


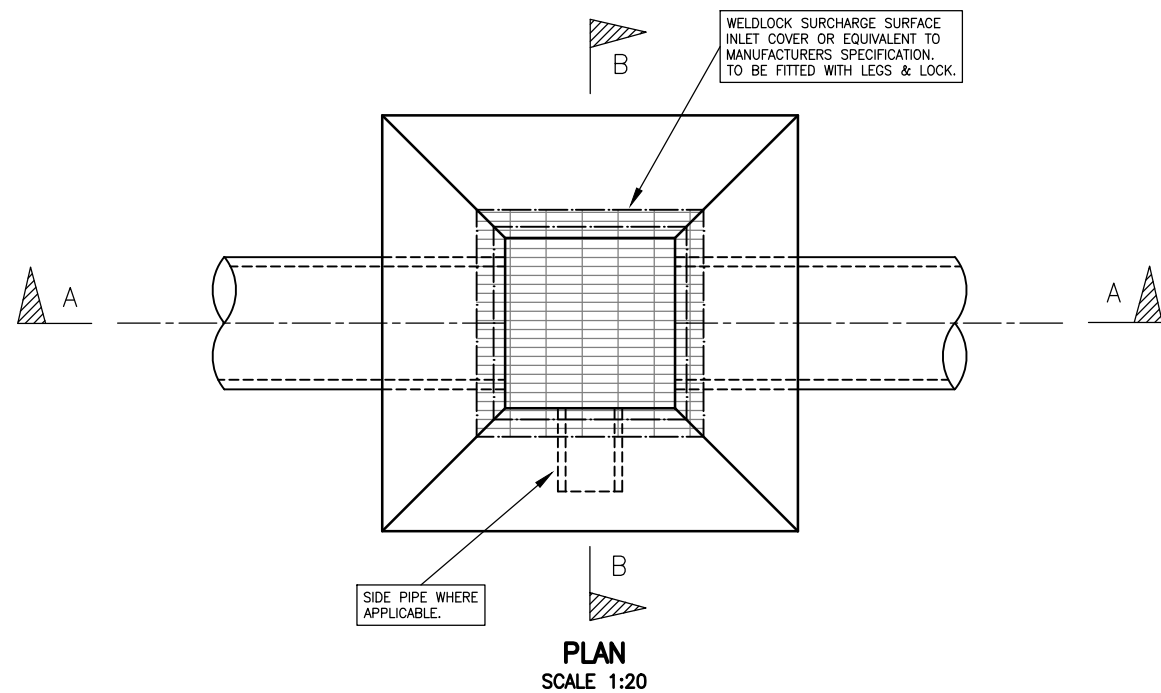


GENERAL NOTES:

1. ALL DIMENSIONS IN MILLIMETRES.
2. ALL CONCRETE TO BE MINIMUM 25MPa.
3. MINIMUM COVER TO REINFORCING STEEL SHALL BE 50.
4. ALL PITS & SURFACE COVERS SHALL BE CAPABLE OF SUPPORTING LOAD CLASS 'B' IN ACCORDANCE WITH AS3996.
5. MINIMUM PIT LENGTH & WIDTH 900x900, TO INCREASE IN EITHER DIRECTION AS REQUIRED TO SUIT PIPE SIZES, ENTRY ANGLE & SITE CONDITIONS.
6. PITS SHALL BE PRECAST TO SURFACE APRON GENERALLY.
7. PITS TO BE CAST IN-SITU IT SHALL BE DESIGNED BY A CERTIFIED ENGINEER.
8. CONSTRUCTION CERTIFICATION OF ALL PITS CAST IN-SITU SHALL BE UNDERTAKEN BY AN ENGINEER EXTERNAL TO COUNCIL.
9. PROVIDE CORROSION RESISTANT STEP IRONS AT 300 CENTRES FOR PITS DEEPER THAN 1200.
10. PIT BASE LEVEL TO MATCH OUTLET PIPE INVERT.

PIT COVER NOTES:

1. COVER TO BE HINGED GALVANISED WELDLOCK SURCHARGE SURFACE INLET COVER OR EQUIVALENT INSTALLED TO MANUFACTURERS SPECIFICATION. TO BE FITTED WITH LEGS & LOCK.

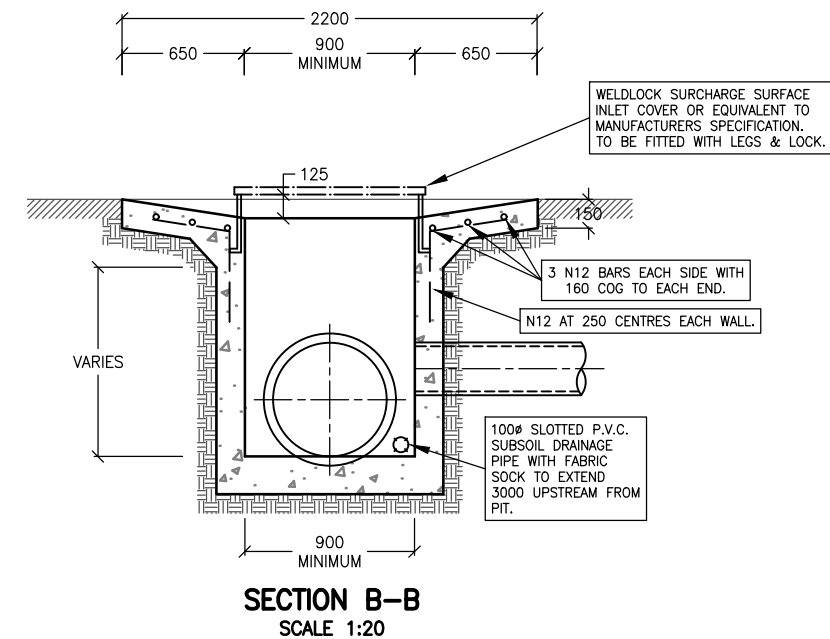

CONSULTANT		REV	DESCRIPTION	INITIALS	DATE	SCALES (A1)		SURVEYED	—	CHECKED		PROJECT		SURFACE INLET/SURCHARGE PIT DETAILS	
		A	ISSUED FOR APPROVAL	DA/BH	18-06-98	1:10	0 0.1 0.2 0.3 0.4 0.5 Metres	1:200	0 2 4 6 8 10 Metres			TECHNICAL SERVICES MANAGER	DESCRIPTION	PLAN, NOTES & CROSS SECTIONS	
		B	NOTE & DRAFTING UPDATES	MC	21-09-23	1:20	0 0.2 0.4 0.6 0.8 1.0	1:500	0 5 10 15 20 25						
		----	----	----	----	1:50	0 0.5 1.0 1.5 2.0 2.5	1:750	0 7.5 15 22.5 30 37.5						
						1:100	0 1 2 3 4 5	1:1000	0 10 20 30 40 50						
CHECKED		APPROVED										DWG No.	SHEET No.	REV.	
												EN7888	01	B	